


REV	DATE	DRAWN	APPROVED	DETAILS OF REVISION
1	5.11.09	DEV	PM	WIRE Nos. CORRECTED.
2	14.12.09	DEV	GH	WIRE COLOURS REVISED PER EDF EMAIL DATED 2.12.09

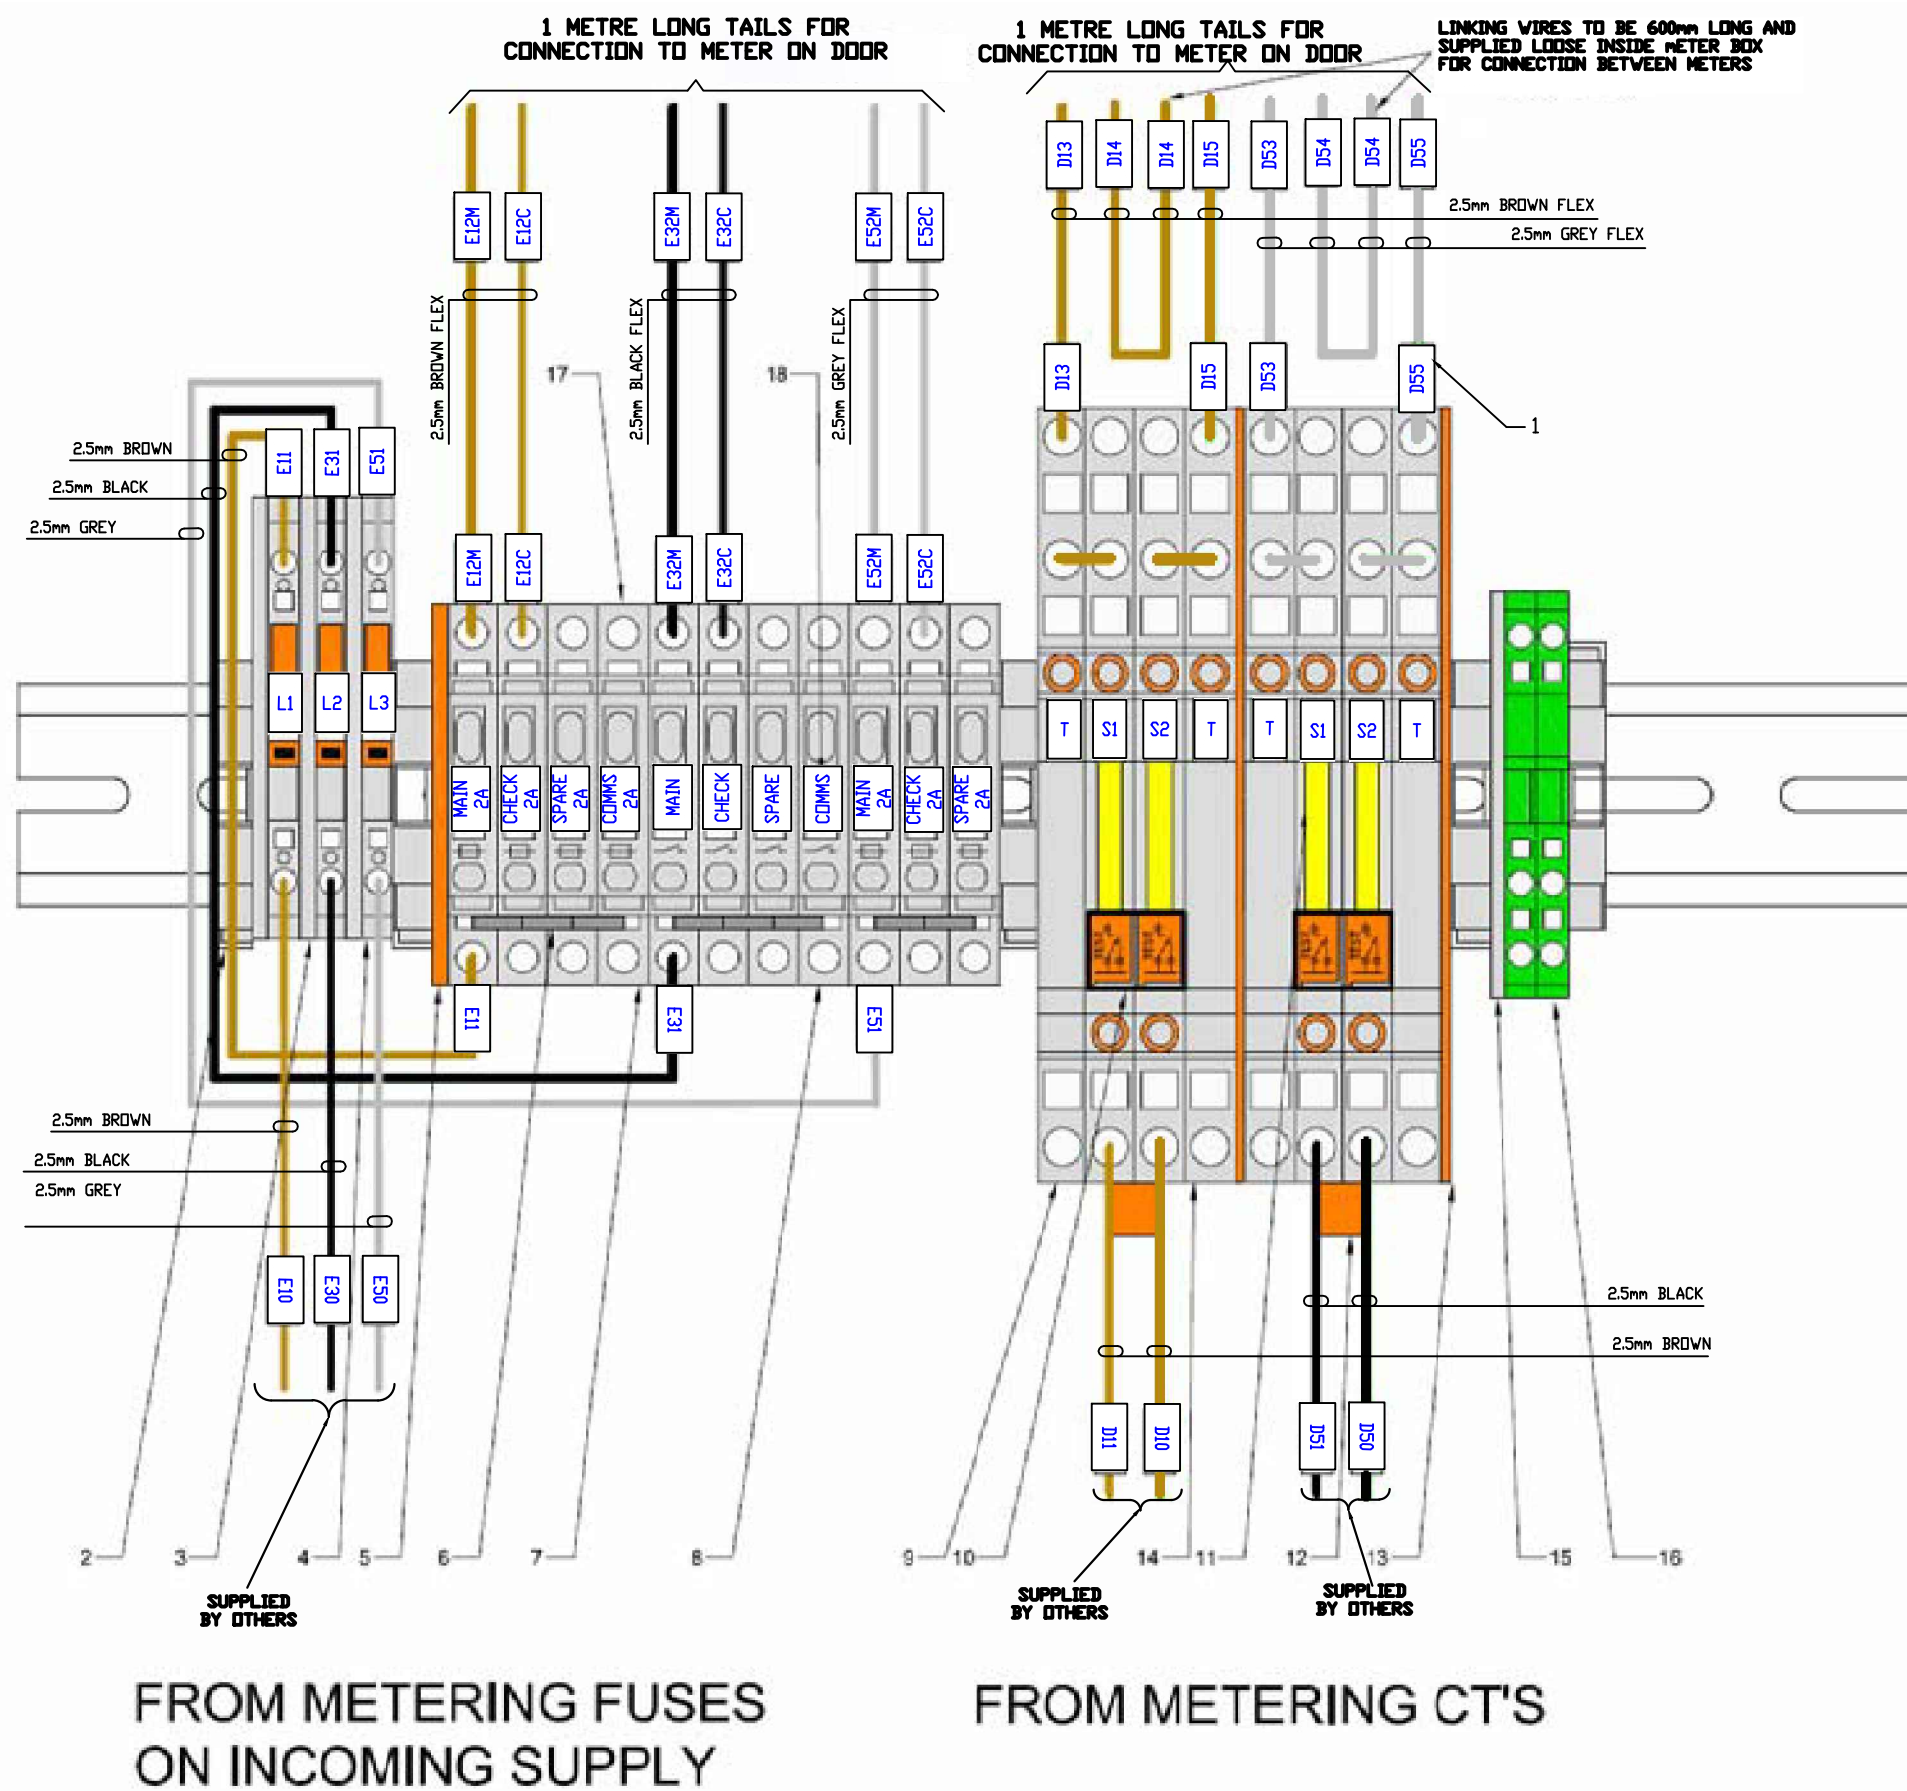

18	0-22	793-501	Markers
17	7	S500-2-R	2A Fuse
16	2	280-687	Earth terminal
15	1	280-324	End plate
14	4	282-870	Current conn. test terminal
13	2	282-386	Orange end plate
12	2	282-424	Orange commoning link
11	4	282-384	Lock out
10	2	282-882	Locking cover
9	4	282-866	Current conn. through term
8	4	281-624	Neutral / Disconnect terminal
7	7	281-611	Voltage / Fuse terminal
6	8	281-402	Commoning Link
5	1	281-309	End plate
4	3	280-870	Isolation terminal
3	3	280-374	End plate
2	5	249-116	End stop
1	-	946593-000	Raychem cable markers
ITEM No	Qty	Part Number	Description

CUSTOMER ORDER No.	CUSTOMER	THIS DRAWING IS THE PROPERTY OF SCHNEIDER ELECTRIC	DRAWN AE DATE 15.05.09 APP'D DEV DATE 15.05.09	SCALE NTS	
MERLIN GERIN CONTRACT No.	EDF ENERGY				

- Merlin Gerin
- Modicon
- Square D
- Telemecanique

WIRING DIAGRAM FOR METERING TERMINATION BOX
 FOR COP 3 HV

DRG No. EECOP3HV-WD